

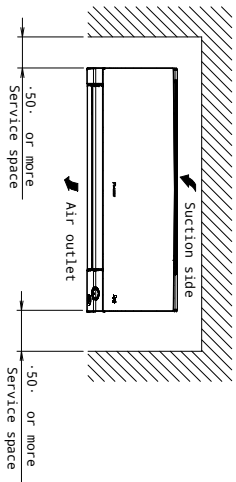
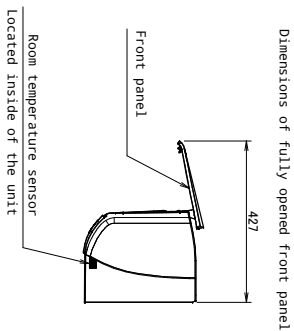






Required space for service and ventilation

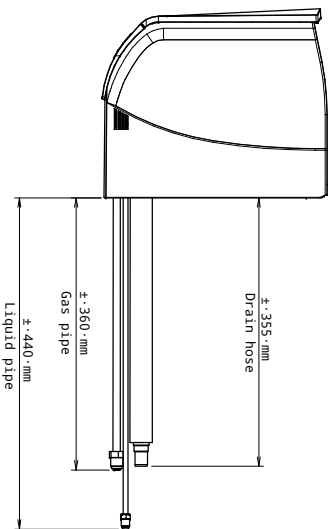

Minimum space for air passage

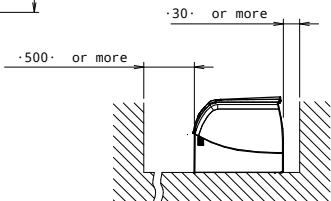

2D148274

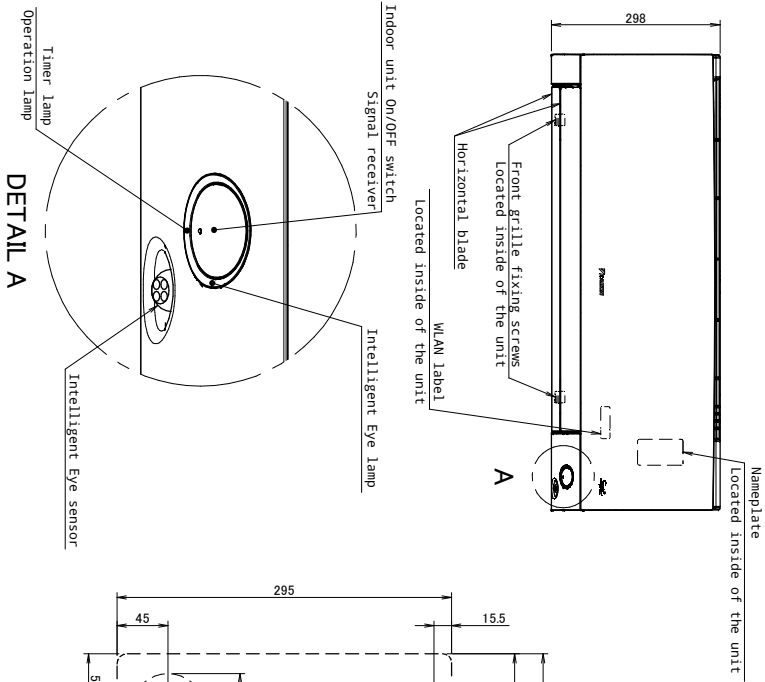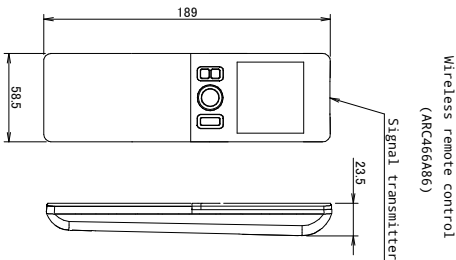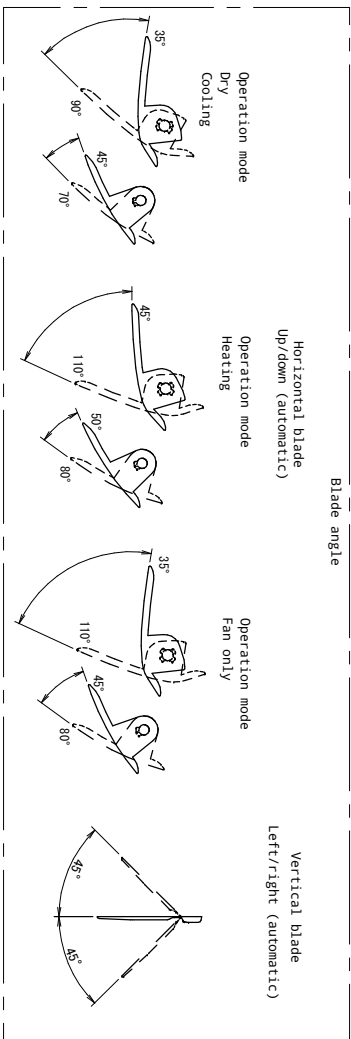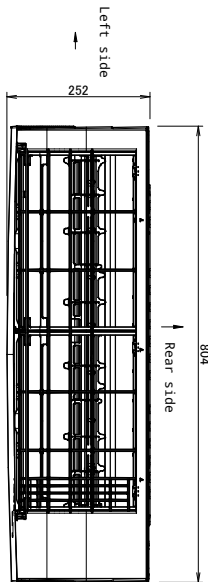

DETAIL A

Notes
1. The . . . mark shows the piping direction.

