

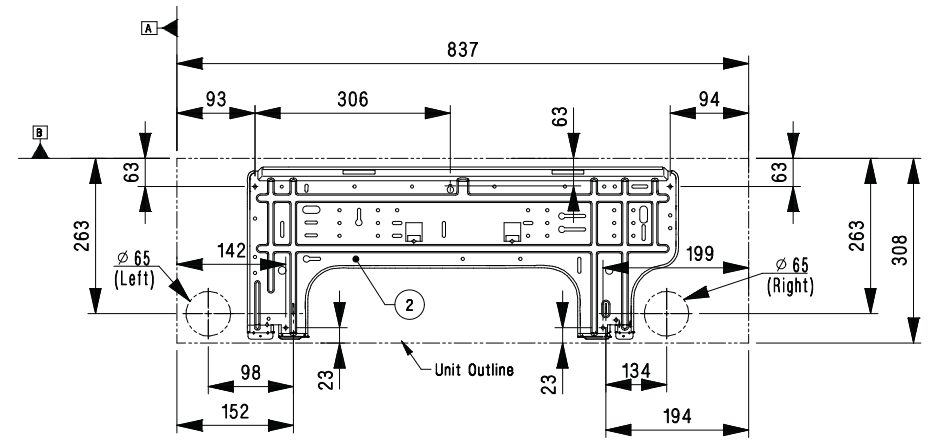
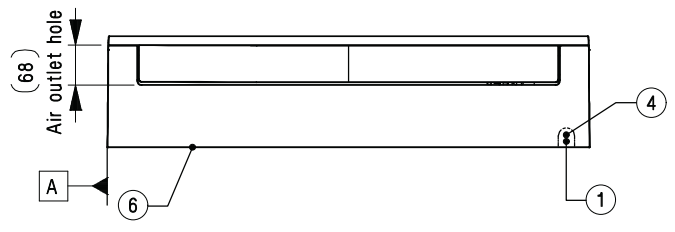
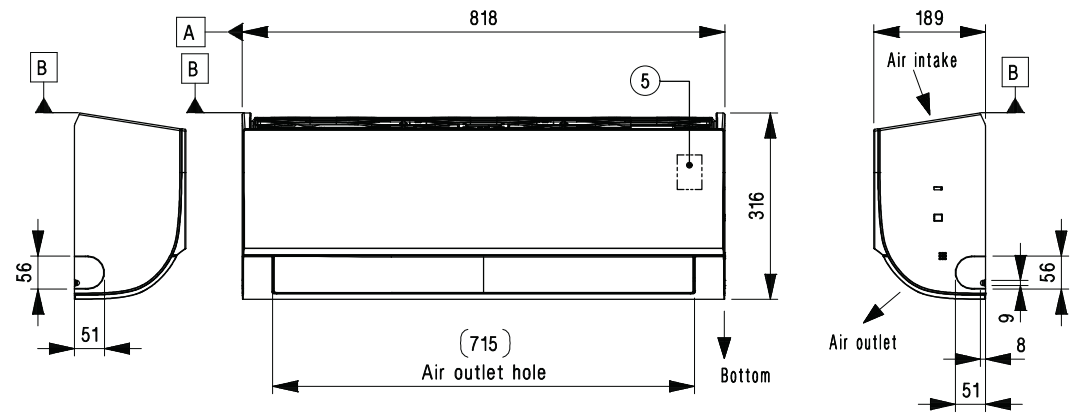


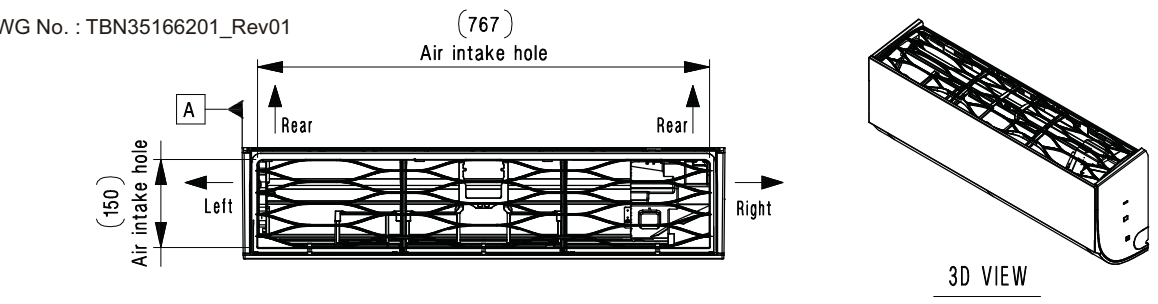

Fixing the installation plate, drilling hole

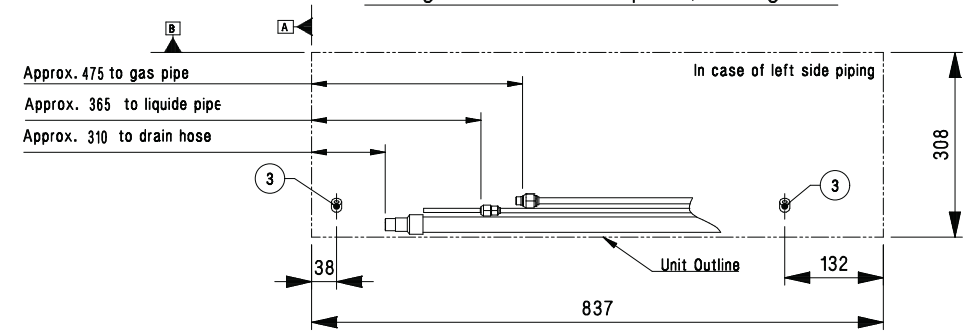


Connecting gas/liquid pipe, drain hose

Symbols	Note
Piping Direction	1. Unit should be installed in compliance with the installation manual in the product box.
Datum line	2. Unit should be grounded in accordance with the local regulations or applicable national codes.
	3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.
	4. Electrical characteristics chapter should be considered for electrical work and design. Especially the power cable and circuit breaker should be selected in accordance with that.

6	Decoration Cover	-
5	Display & Remote Controller Signal Receiver	-
4	Terminal Block for Power Supply Communication	-
3	Drain hose connection	-
2	Installation Plate	-
1	Refrigerant/Drain pipe and cable routing hole	Knock-out type
No.	Part Name	Description





UUA1.ULO
Chassis code: UL2

(Unit: mm)

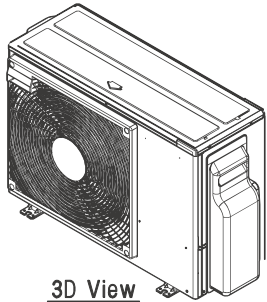

3D View

Onderdeel	
1	Luchtuittrede
2	Control Box
3	Voeding en communicatiekabeldoorvoer
4	Gasleidingaansluiting
5	Vloeistofaansluiting
6	Geleidingsgat stroom- en communicatiekabel
7	Geleidingsgat koelmiddelleiding
8	Handgreep
9	Deksel luchtsensor temperatuur

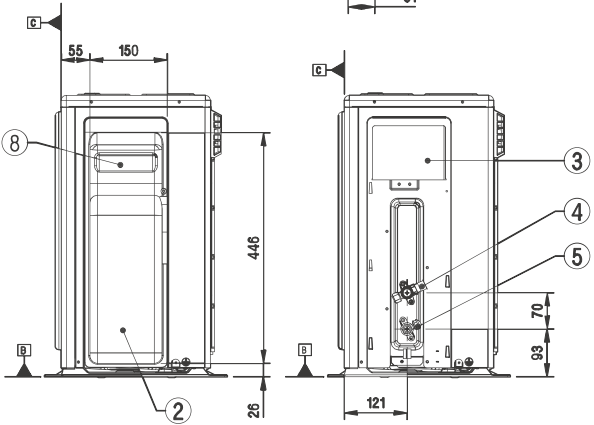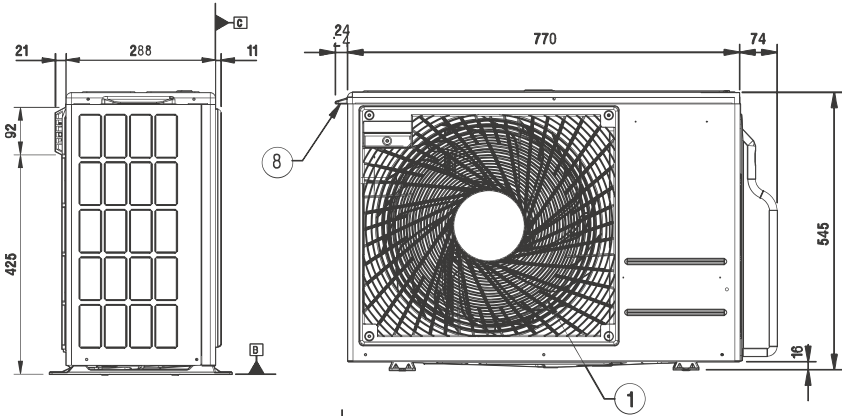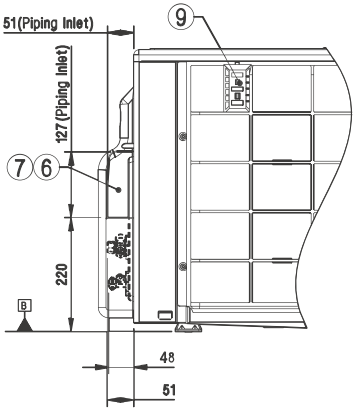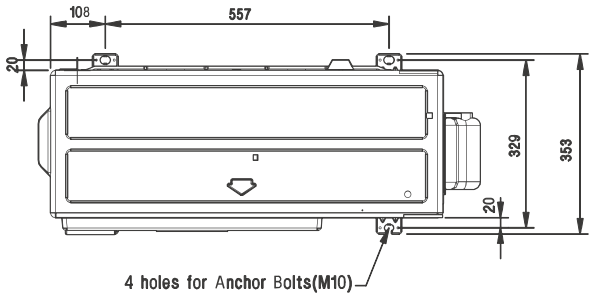

Side View
(removed valve cover)

