


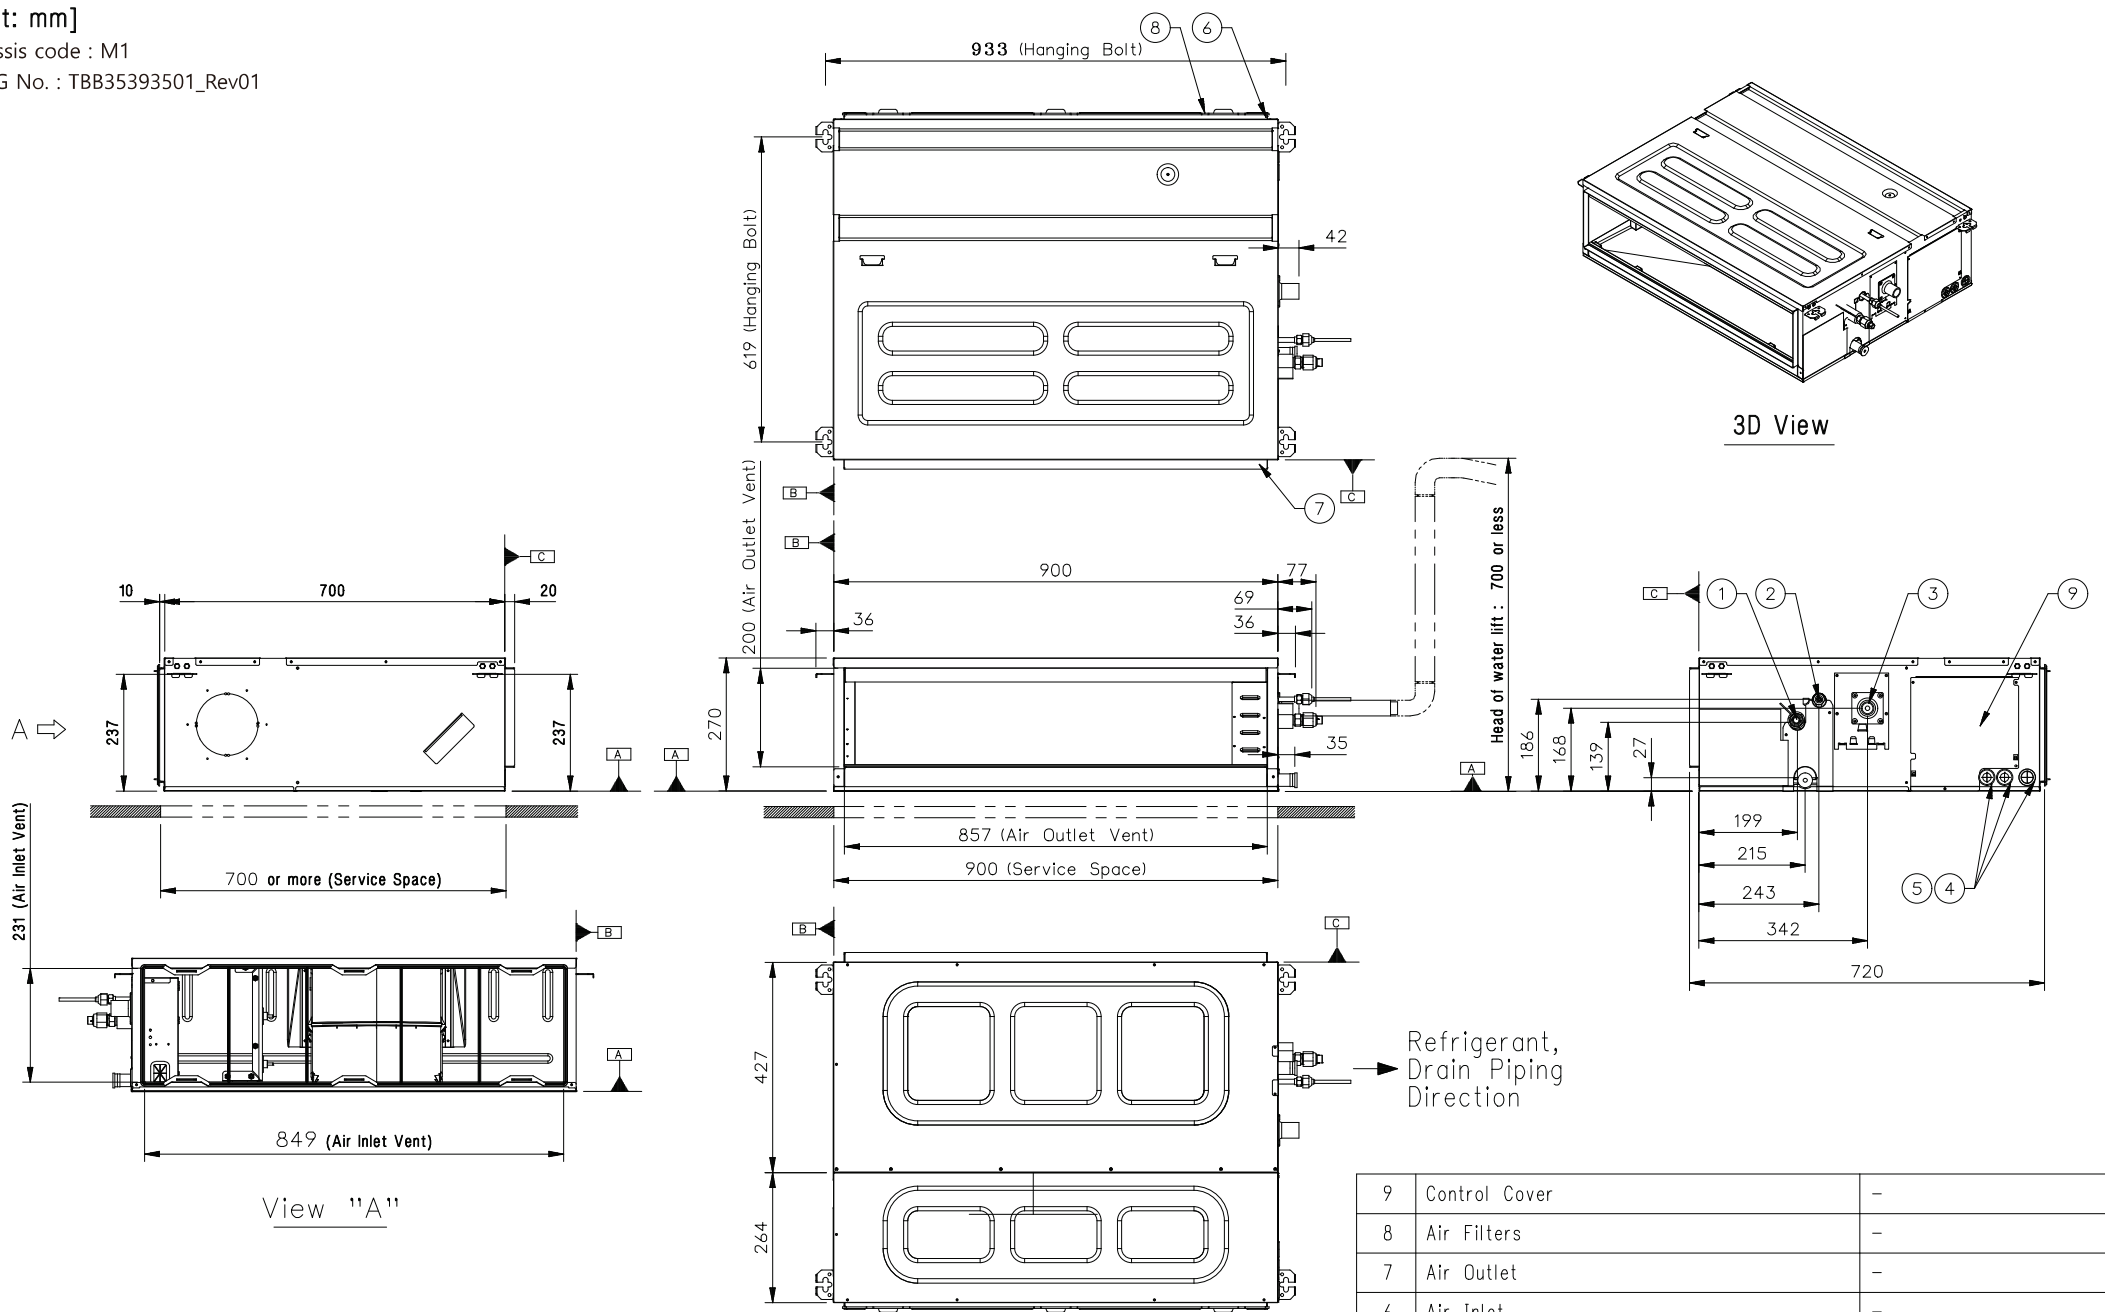

Symbols		Note 1. Unit should be installed in compliance with the installation manual in the product box. 2. Unit should be grounded in accordance with the local regulations or applicable national codes. 3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.	4	Power and communication Cable Hole	–
	Datum line		3	Drain pipe connections	–
	View Direction		2	Liquid pipe connections	–
	Refrigerant/ Drain Piping Direction		1	Gas pipe connections	–
			No.	Part Name	Description