

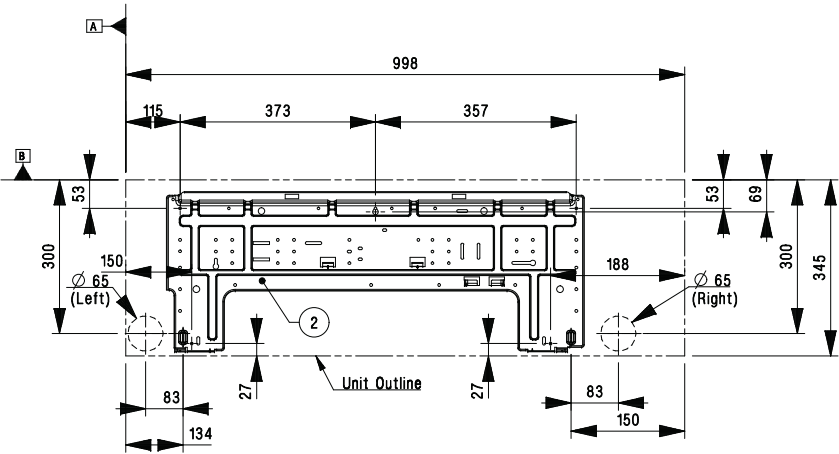


3D VIEW

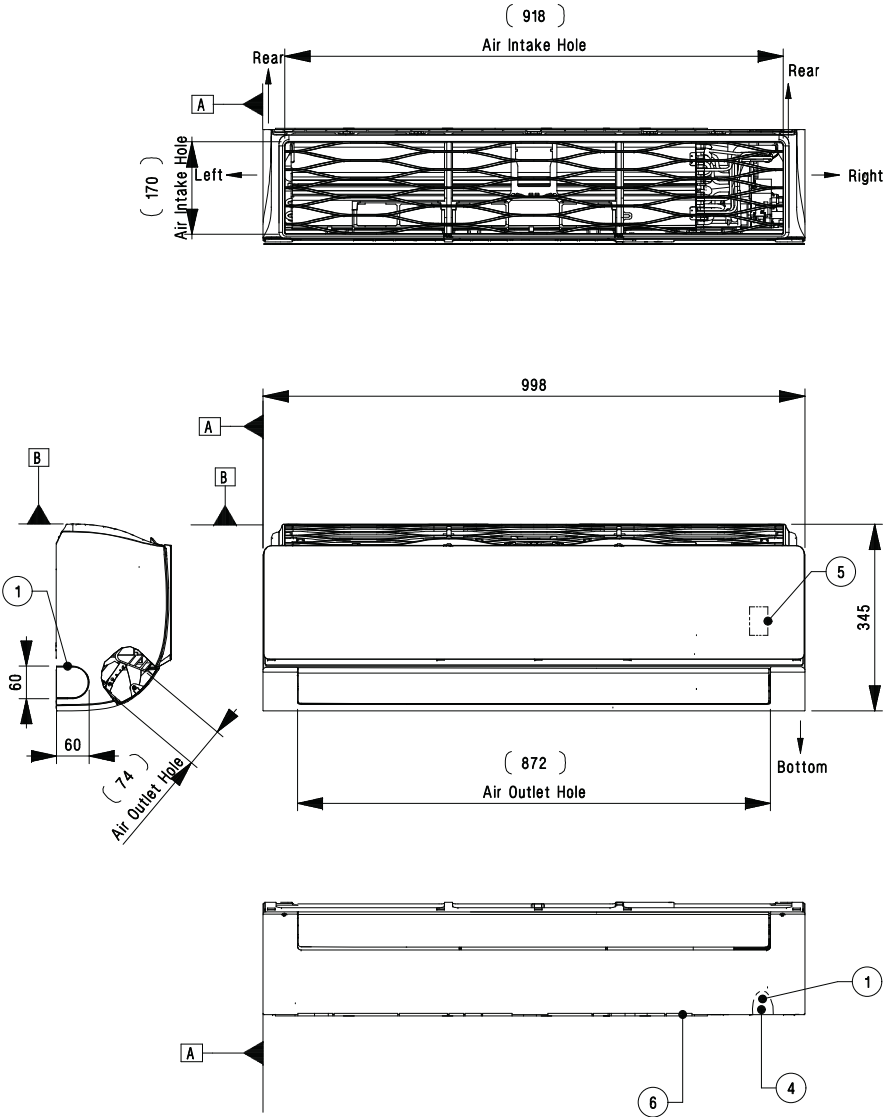


Fixing the installation plate, drilling hole

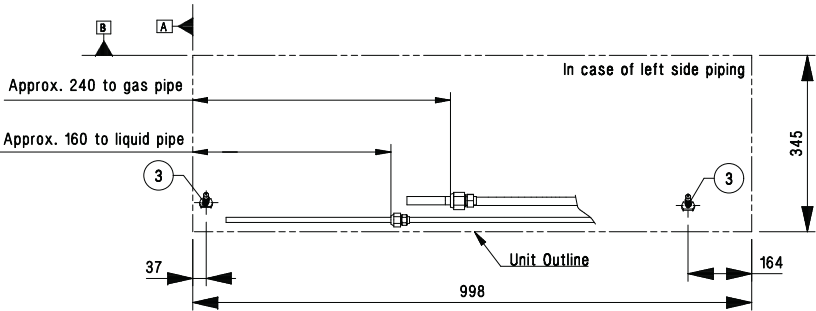

Connecting gas/liquid pipe

Symbols





Note

1. Unit should be installed in compliance with the installation manual in the product box.
2. Unit should be grounded in accordance with the local regulations or applicable national codes.
3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.
4. Electric characteristics chapter should be considered for electrical work and design. Especially the power cable and circuit breaker should be selected in accordance with that.

|     |                                                   |                |
|-----|---------------------------------------------------|----------------|
| 6   | Decoration Cover                                  | -              |
| 5   | Display & Remote Conroller Signal Reciver         | -              |
| 4   | Terminal Block for Power Supply and Communication | -              |
| 3   | Drain hose connection                             | -              |
| 2   | Installation Plate                                | -              |
| 1   | Refrigerant/Drain pipe and cable routing hole     | Knock-out type |
| No. | Part Name                                         | Description    |

(Unit: mm)

**PC18SQ.UL2**  
**DC09RH.UL2 / DC12RH.UL2**  
**AC18BH.UL2**  
**A09FT.UL2 / A12FT.UL2**

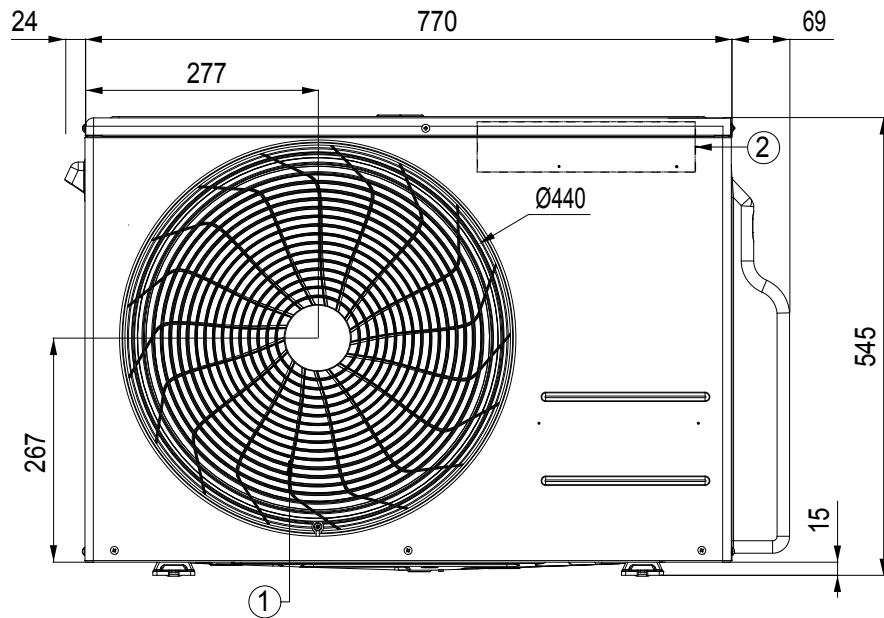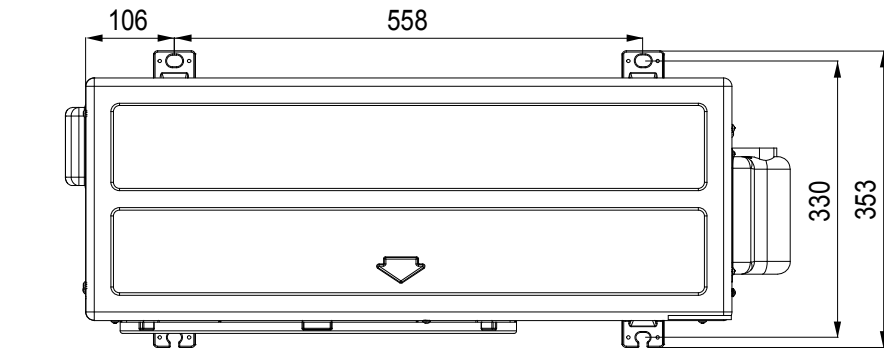

|   | Onderdeel                            |
|---|--------------------------------------|
| 1 | Luchtuittrede                        |
| 2 | Control Box                          |
| 3 | Voeding en communicatiekabeldoorvoer |
| 5 | Zuiggasleidingaansluiting            |
| 6 | Vloeistofaansluiting                 |

